VYNCO

INSTALLATION INSTRUCTIONS

INDUSTRY ENCLOSURES IP66

VIE SERIES

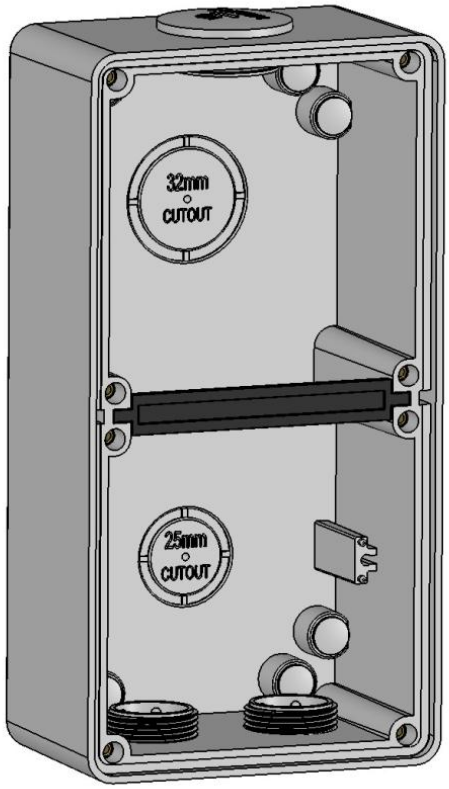

SAFETY

Please read all instructions prior to wiring and use of this product.

Always ensure power is switched off/isolated on circuit before installation, internal cleaning or maintenance.

This product should be wired up by a suitably qualified person in accordance with Australian and New Zealand wiring rules AS/NZS 3000.

CLEANING INSTRUCTIONS

To maintain the durability and longevity of the product, neutral based chemicals are best suited.

WARRANTY

The warranty protects against defects in workmanship and material. Any defects will be rectified by replacement if the goods are returned to place of purchase, with proof of purchase, and with a brief explanation of the experienced fault.

The warranty does not include compensation for any associated expenses involving installations or removal, such as labour or travel.

The warranty becomes null and void if, in our opinion, the product has been misused, tampered with, incorrectly installed, or subjected to power surges.

ENCLOSURE CODES & SIZES				
Code	Width mm	Depth mm	Height mm	Conduit entries
VIE1	101	63	101	2X25 / 1X32
VIE1S	101	42	101	2X20 / 1X25
VIE2	101	63	198	2X25 / 1X32
VIE2S	101	42	198	2X20 / 1X25
VIE3	101	63	294	2X25 / 2X32
VIE4	198	63	198	2X25 / 2X32

VYNCO INDUSTRIES (NZ) LIMITED

CHRISTCHURCH
388 Tuam Street, Phillipstown, Christchurch, 8011
PO Box 9022, Tower Junction, Christchurch 8149
New Zealand
P +64 3 379 9283 F +64 3 379 6838
E sales@vynco.co.nz

AUCKLAND
9 Levene Place, Mount Wellington
PO Box 12 249, Penrose, Auckland 1061
New Zealand
P +64 9 525 6051 F +64 9 525 5799

VYNCO.CO.NZ

VYNCO

INSTALLATION INSTRUCTIONS

INDUSTRY ENCLOSURES IP66

VIE SERIES

INSTALLATION INSTRUCTIONS:

Note:
All enclosures supplied with reducers and screw caps. Conduit entries supplied fitted with caps including O-ring seals.

1. Prepare base by drilling out screw holes for mounting to surface.
2. When installing, fit screw caps over mounting screws and use a suitable neutral cure sealant.
3. Where bridges are to be used, apply sealant to slots in base.

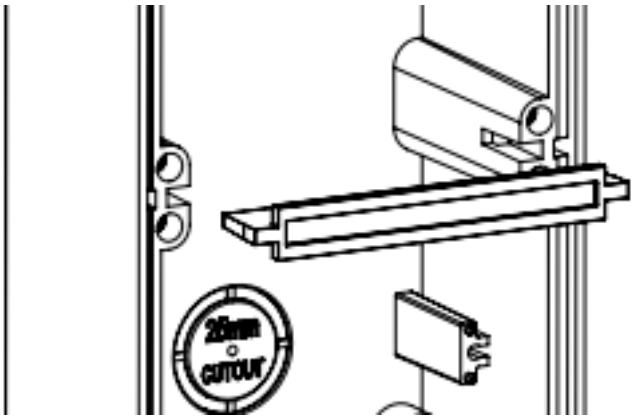

Fit modules to base as detailed in respective product instructions.

Use only neutral cure sealant that is suitable for use with polycarbonate plastics. When using any sealant, apply according to the manufacturer's instructions.

Suitable for indoor and exposed outdoor use

For all other specifications for the INDUSTRY range, refer to our website, www.vynco.co.nz

VYNCO INDUSTRIES (NZ) LIMITED

CHRISTCHURCH
388 Tuam Street, Phillipstown, Christchurch, 8011
PO Box 9022, Tower Junction, Christchurch 8149
New Zealand
P +64 3 379 9283 F +64 3 379 6838
E sales@vynco.co.nz

AUCKLAND
9 Levene Place, Mount Wellington
PO Box 12 249, Penrose, Auckland 1061
New Zealand
P +64 9 525 6051 F +64 9 525 5799

VYNCO.CO.NZ